




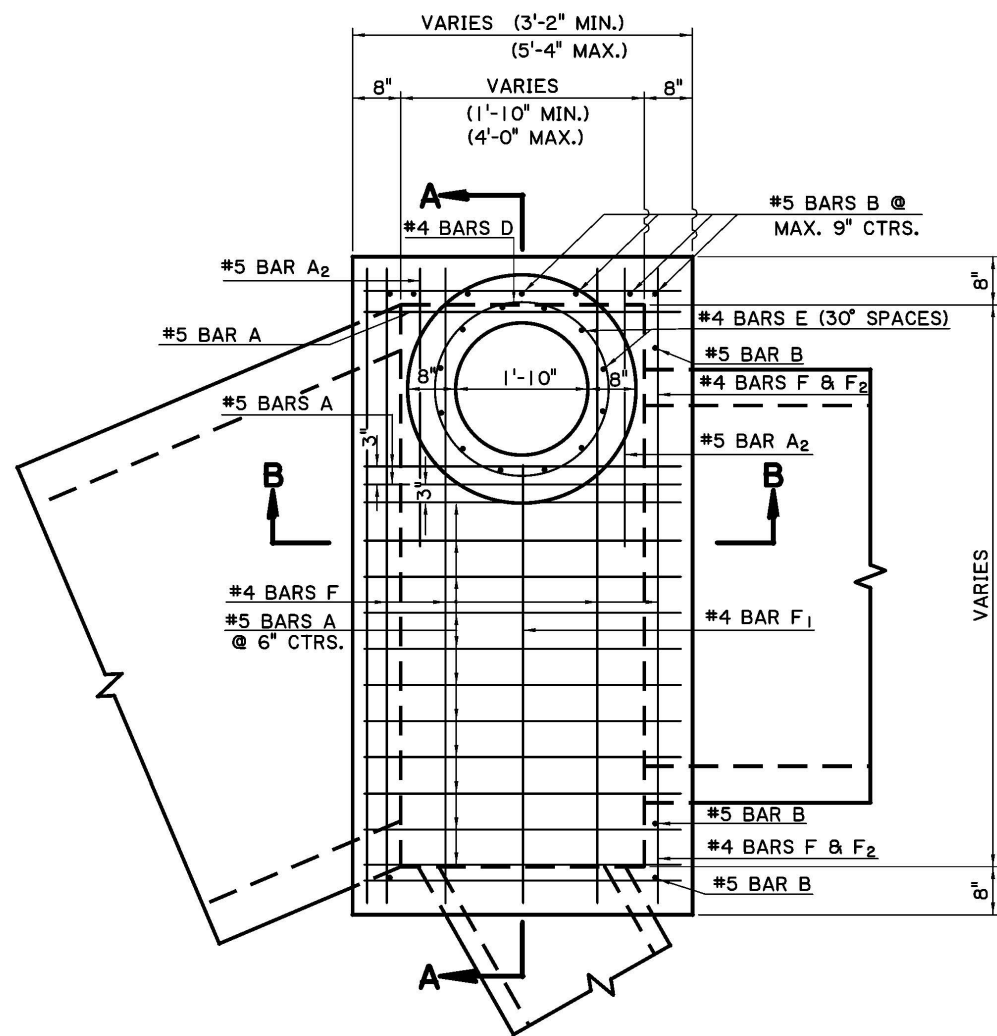


PLAN

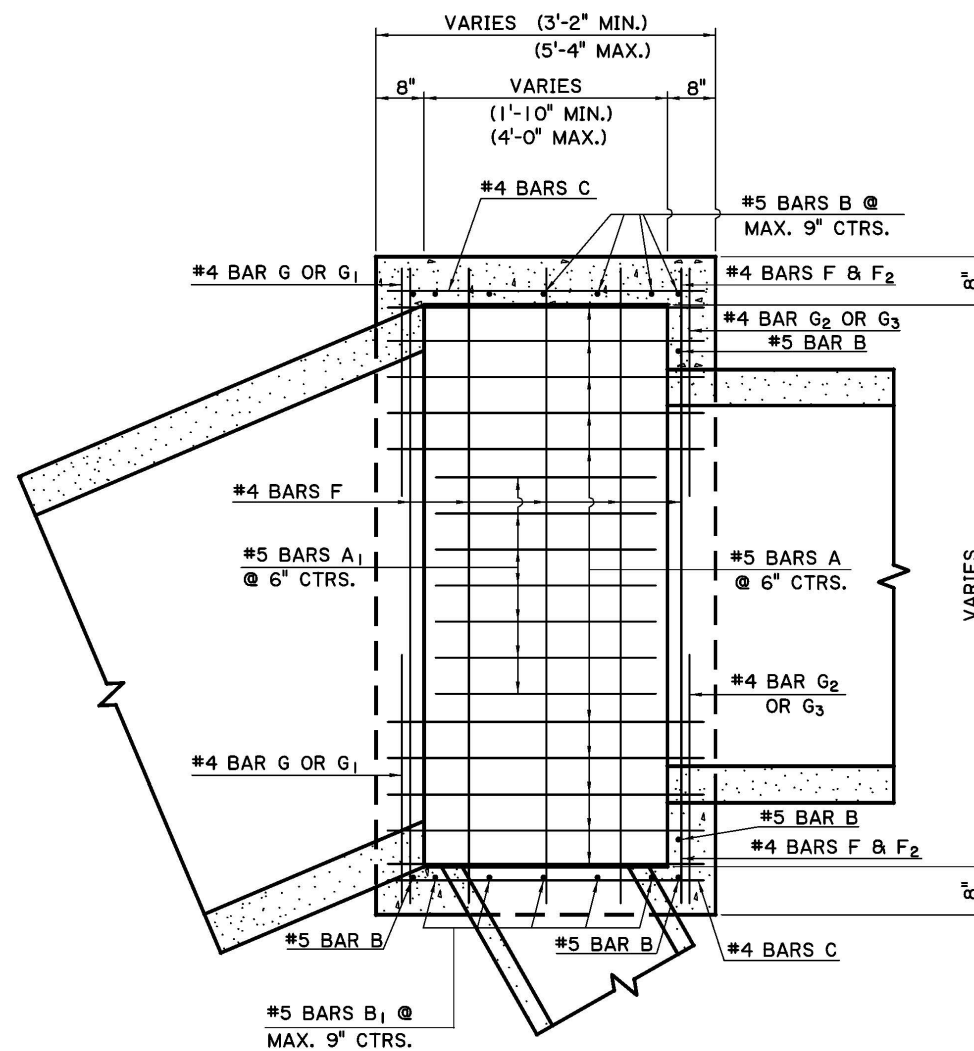

SECTION C-C

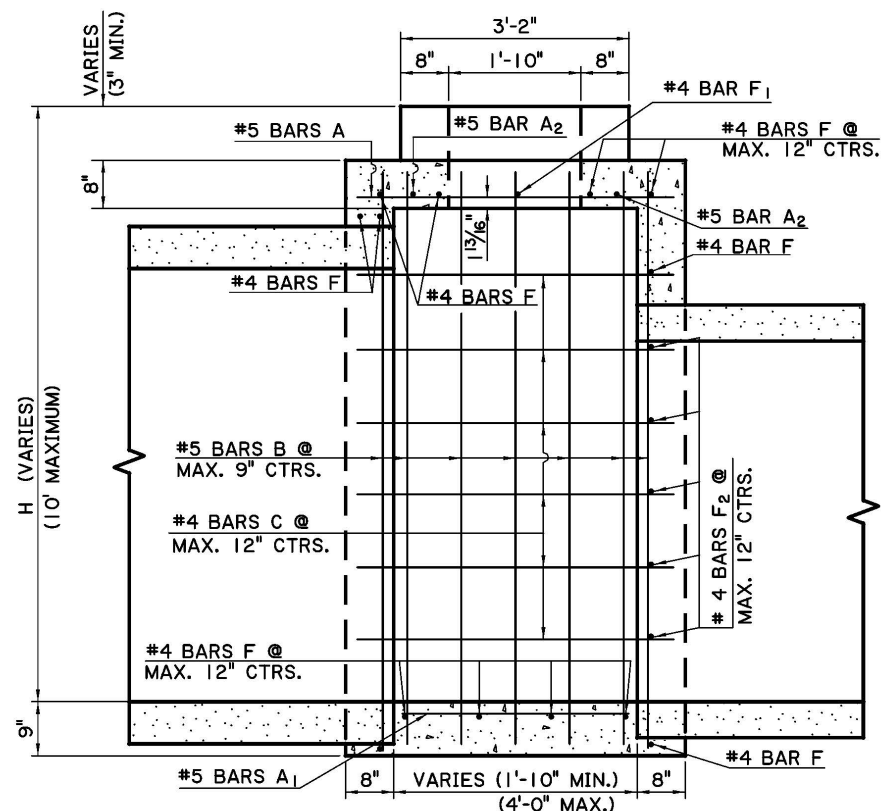


SECTION B-B

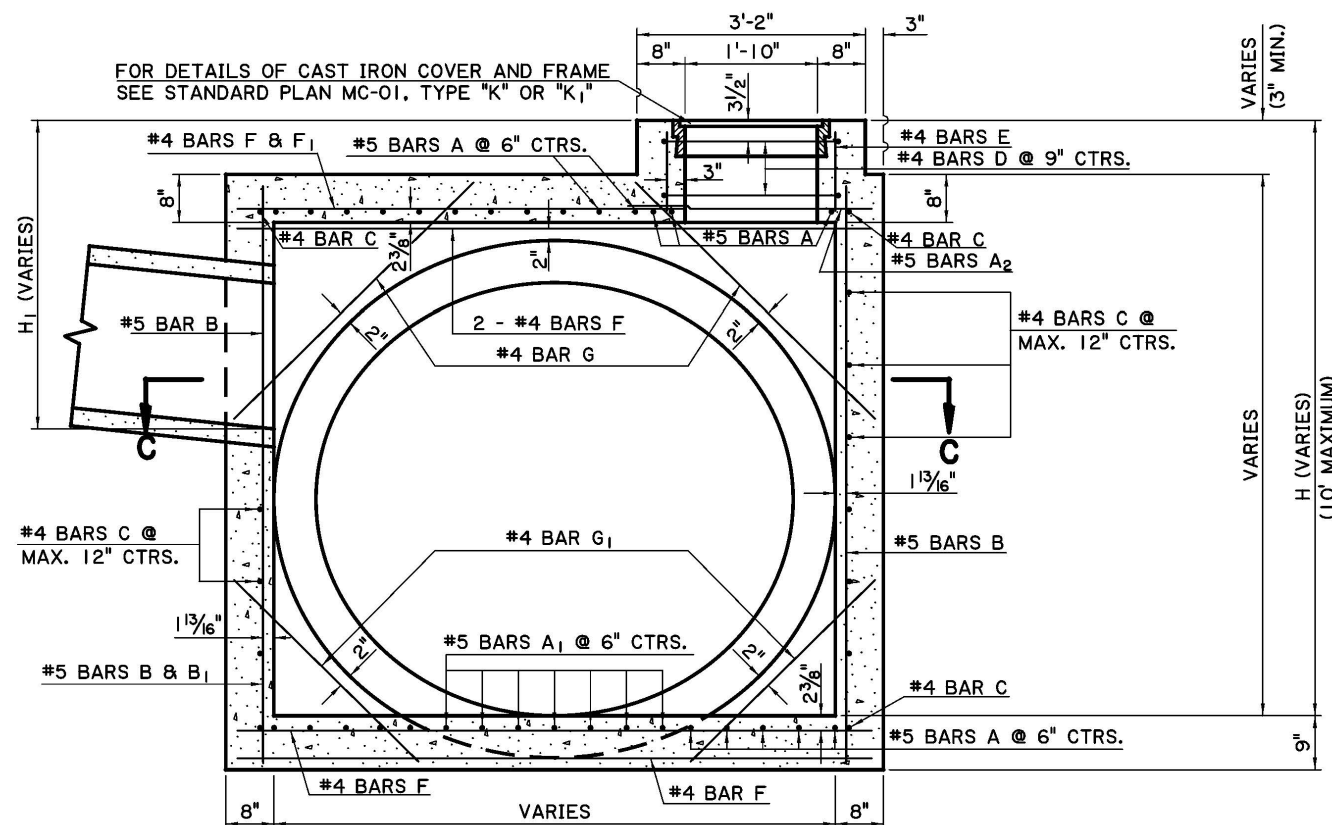

SECTION A-A


GENERAL NOTES:

1. MANHOLE IS DESIGNED ACCORDING TO 4TH ED. 2007 AASHTO LRFD PROCEDURES. SECTION 702 OF THE DOTD STANDARD SPECIFICATIONS SHALL APPLY.
2. CONCRETE: ALL CONCRETE SHALL BE CLASS "M" MINOR STRUCTURE. ALL EXPOSED EDGES SHALL BE CHAMFERED 3/4 IN. EXCEPT AS NOTED.
3. REINFORCING STEEL: REINFORCING STEEL SHALL BE GRADE 60. DIMENSIONS ARE TO BAR CENTERS. MINIMUM COVER FOR REINFORCING BARS SHALL BE 2 IN. CLEAR UNLESS SHOWN OTHERWISE.
4. SEE "DETAIL A" FOR DETAILS OF MANHOLE IN A PAVEMENT AREA.
5. THE CONTRACTOR WILL NOT POUR ABOVE THE BOTTOM OF THE SLAB UNTIL THE PAVING ADJACENT TO THE MANHOLE HAS BEEN COMPLETED.

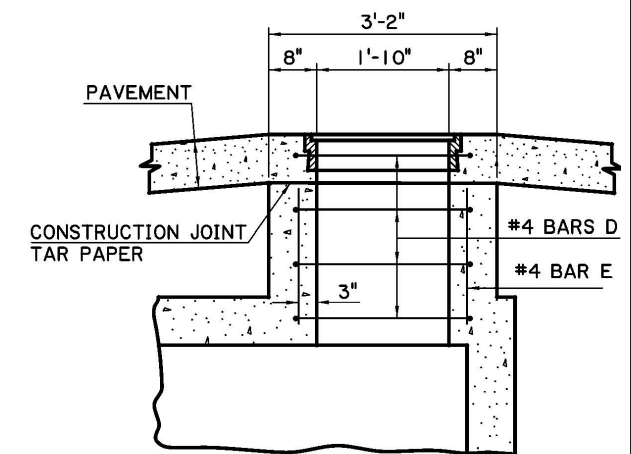

DETAIL A

(MANHOLE IN PAVEMENT AREA)

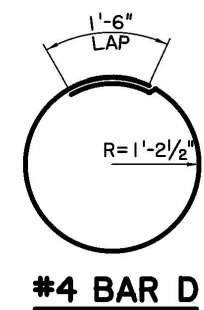

SHEET NUMBER		PARISH		CONTROL SECTION		STATE PROJECT	
DESIGN	CHECK	DETAIL	CHECK	REVIEW	SERIES	1 OF 1	
APPROVED BY CHIEF ENGINEER:				DATE: 6/1/2024			
REVISION OR CHANGE ORDER DESCRIPTION				BY			
NO.				DATE			
				CONCRETE MANHOLE MAX. PIPE: 36" RCP X OPEN MAX. DEPTH: 10'			
				STANDARD PLAN			