




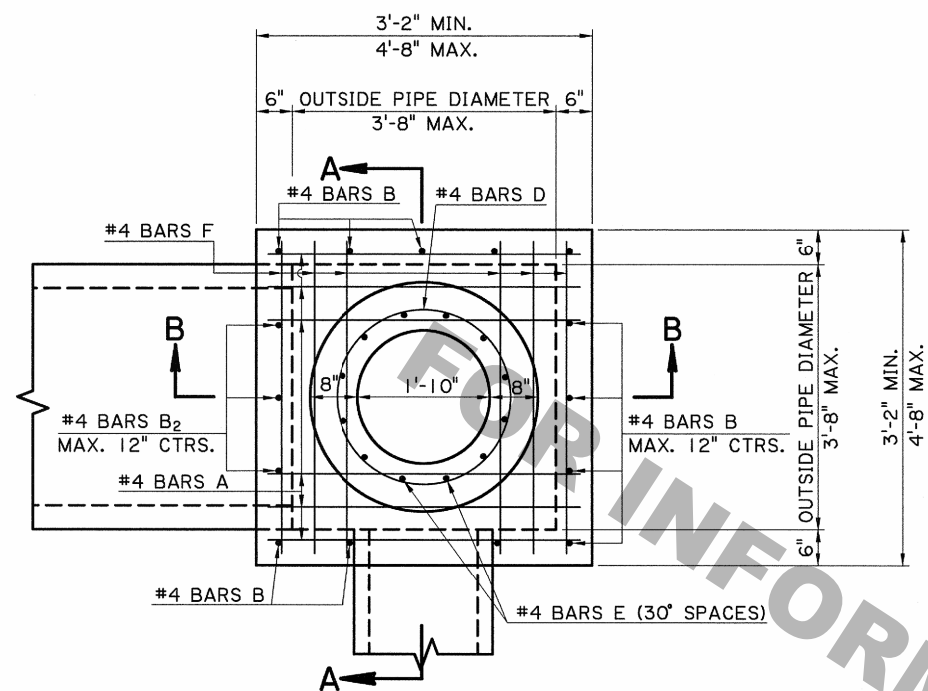


PLAN

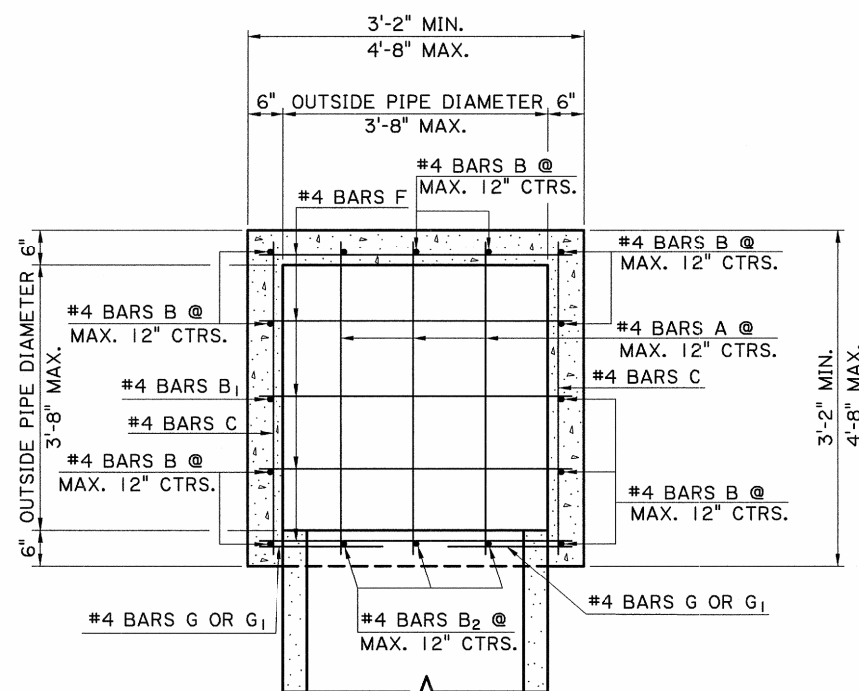


SECTION C-C



#4 BAR D

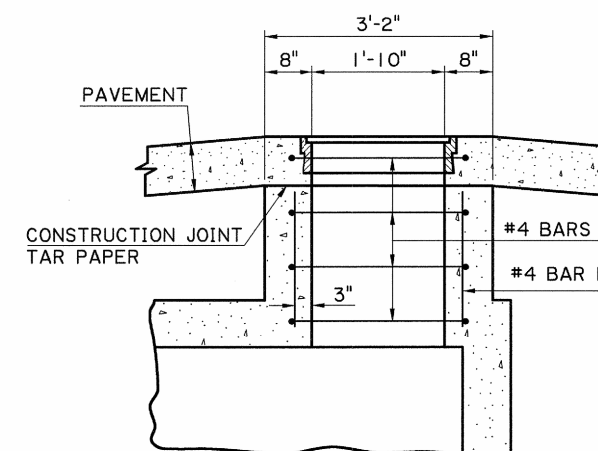


DETAIL A
(MANHOLE IN PAVEMENT AREA)

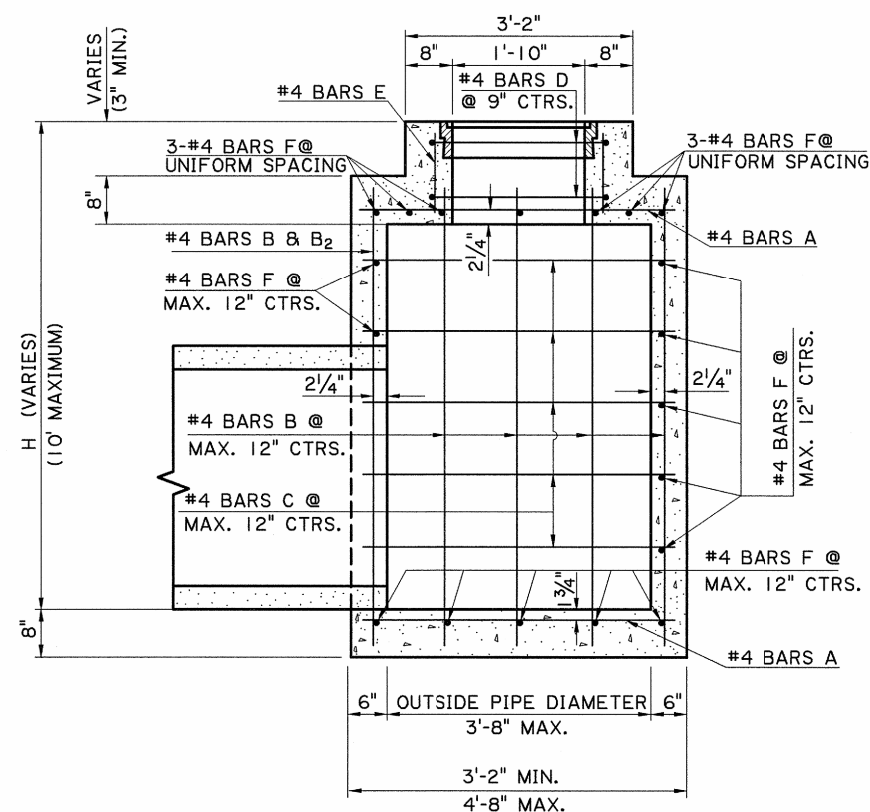

SECTION B-B

FOR DETAILS OF CAST IRON COVER AND FRAME
SEE STANDARD PLAN MC-01, TYPE "K" OR "K1"

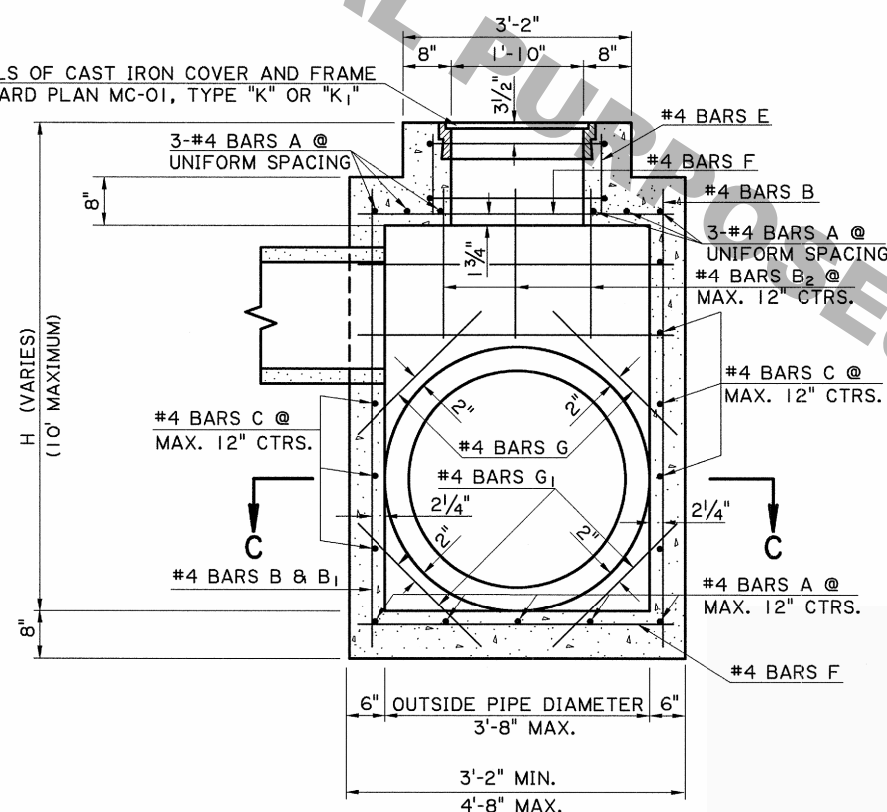

SECTION A-A

GENERAL NOTES:

1. MANHOLE IS DESIGNED ACCORDING TO 4TH ED. 2007 AASHTO LRFD PROCEDURES. SECTION 702 OF THE DOTD STANDARD SPECIFICATIONS SHALL APPLY.
2. CONCRETE: ALL CONCRETE SHALL BE CLASS "M" MINOR STRUCTURE. ALL EXPOSED EDGES SHALL BE CHAMFERED $\frac{3}{4}$ IN. EXCEPT AS NOTED.
3. REINFORCING STEEL: REINFORCING STEEL SHALL BE GRADE 60. DIMENSIONS ARE TO BAR CENTERS. MINIMUM COVER FOR REINFORCING BARS SHALL BE 2 IN. CLEAR UNLESS SHOWN OTHERWISE.
4. SEE "DETAIL A" FOR DETAILS OF MANHOLE IN A PAVEMENT AREA.
5. THE CONTRACTOR WILL NOT POUR ABOVE THE BOTTOM OF THE SLAB UNTIL THE PAVING ADJACENT TO THE MANHOLE HAS BEEN COMPLETED.

	CONCRETE MANHOLE MAX. PIPES: 36" RCP X 36" RCP MAX. DEPTH: 10'			DESIGNED	Q.A. HESTER	PARISH FEDERAL PROJECT	SHEET NUMBER
				CHECKED	J.B. SMART		
				DETAILED	Q.A. HESTER		
				CHECKED	T.B. SMART		
DATE APPROVED BY		REVISION DESCRIPTION 3-1-11 REDRAFTED, REVISED TO AASHTO LRFD PROCEDURES 4-6-76 NOTE ON POURING SEQUENCE	DATE	DEC. 1940	STATE		