

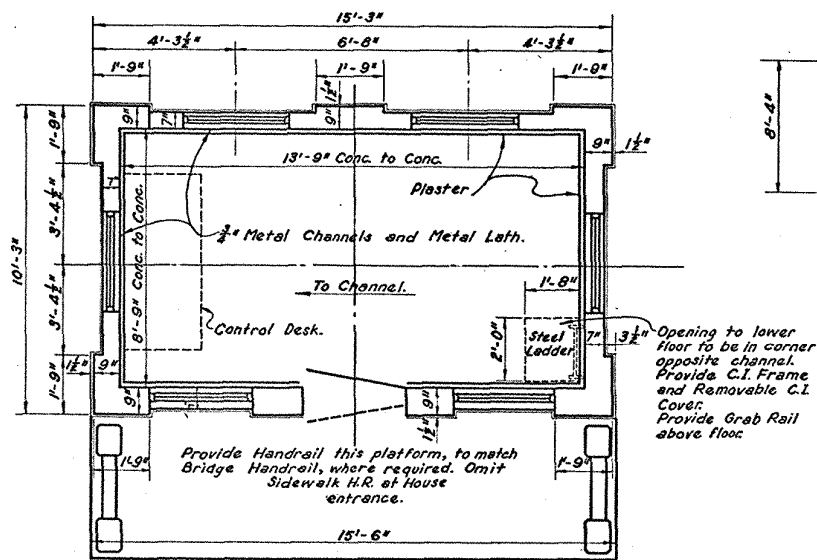



General Notes:
 Construction Specs: Latest approved La. Hwy. Dept. Std. Specs.
 Design Specs.: La. Hwy. Commission 1940.
 Reinforcing Steel dimensions are to bar centers. Provide $\frac{3}{8}$ " bars each face of all walls @ 6" ctrs. both ways and $\frac{3}{8}$ " bars @ 12" ctrs. in floor and roof slabs perpendicular to main reinforcement. All concrete to be Class A, and all exposed surfaces to have a "Rubbed Finish." Interior of Operator's Room to be plastered over Metal Channels and Lath and floor of Operator's Room to be covered with $\frac{1}{2}$ " Red floor tile and base. All windows and doors to be metal. Windows to be Std. size to fit opening approx. 3'-0" x 5'-2". All openings to be screened with 18 mesh copper screening unless otherwise noted. Doors to be fitted with tumbler locks. Metal windows, doors, and trim to be painted to match plaster and concrete. All materials required to complete Operator's House to be included in lump sum bid for house except precast concrete piles which are to be paid for at the price bid for that item. When electric current is available two drop lights and two service outlets shall be provided in each room. All hardware shall be Solid Brass. Downspouts shall be made of 16 oz. Hard Copper. They shall be held in position by Brass or Copper straps, $\frac{3}{8}$ " x 12" spaced not more than 6' ctrs. Straps shall be soldered to the Downspouts and fastened to concrete clear of wall by Brass Screws set in Lead Sheaves. All Windows and Doors to be Weather-Stripped with all Metal Brass or Bronze Weather Strips. Doors to have Brass or Bronze Thresholds.

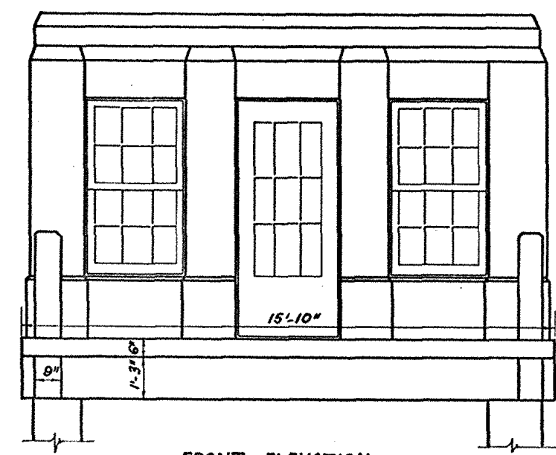


UPPER FLOOR PLAN
 Lower Floor Similar except for opening in floor and as shown in other Views.
 No handrail req'd on Lower Platform.
SECTION B-B

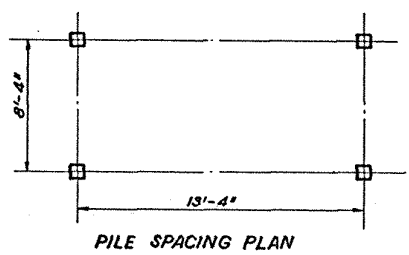


FRONT ELEVATION
 One Story House

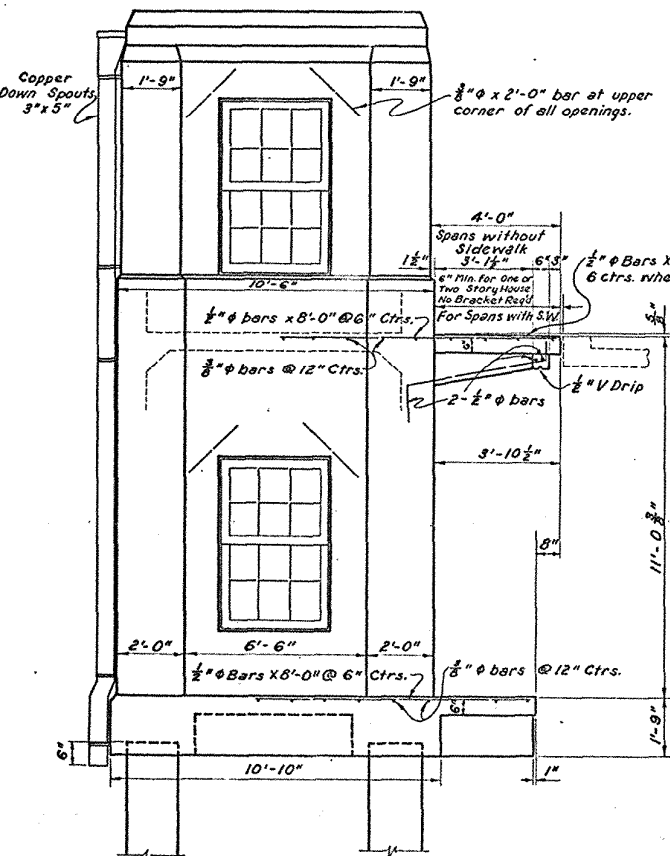


SIDE ELEVATION

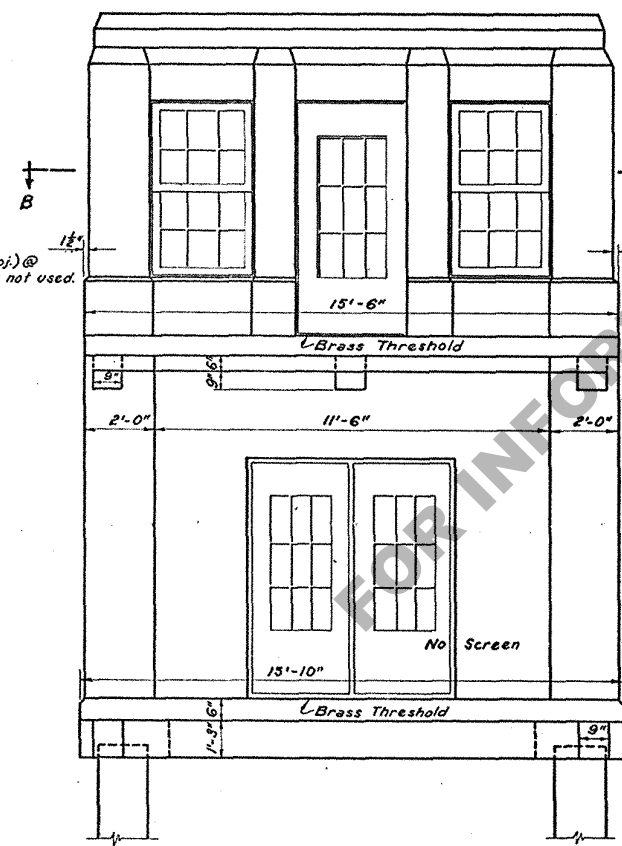

FRONT ELEVATION

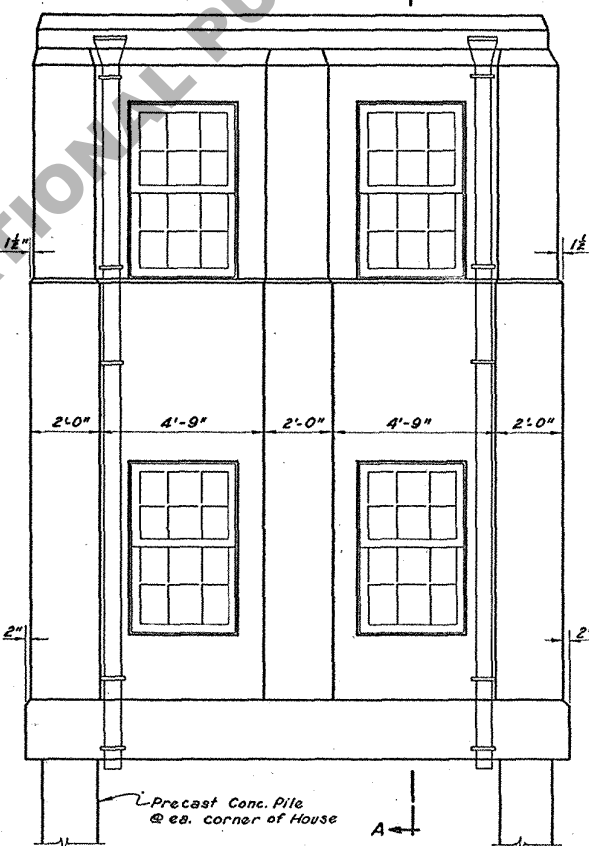

REAR ELEVATION

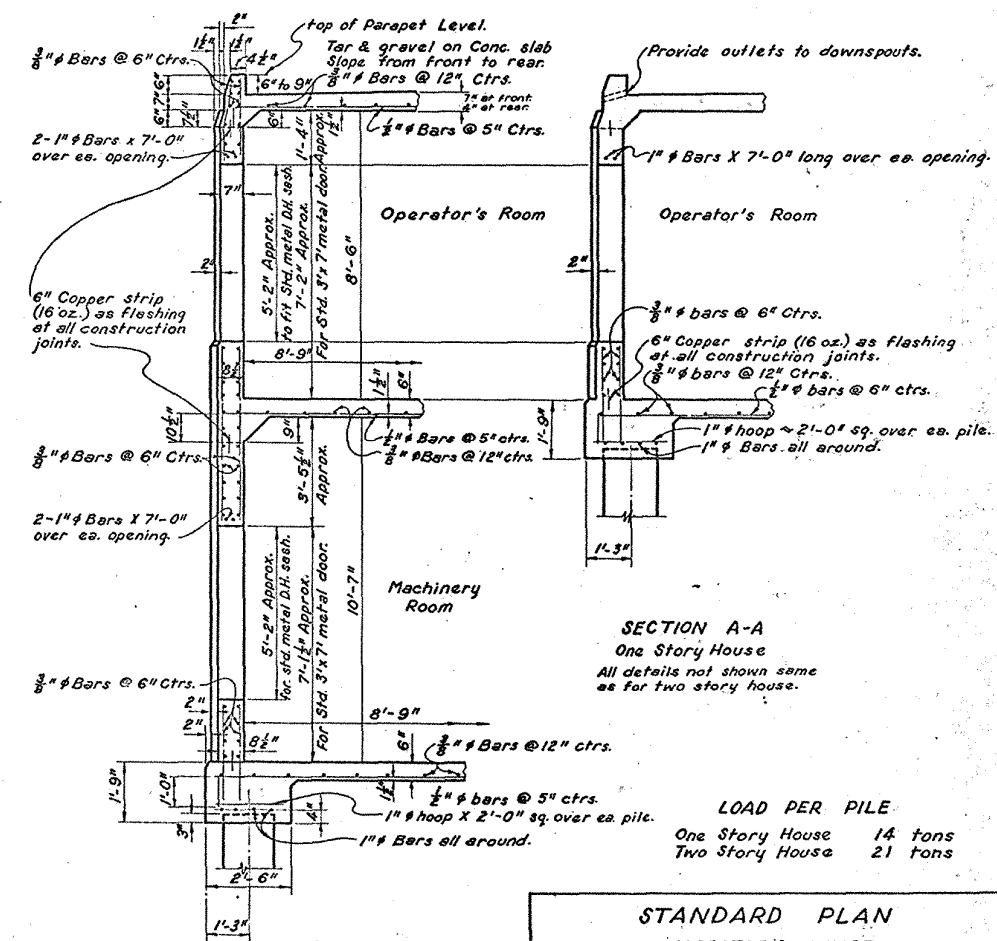

SECTION A-A
 One Story House
 All details not shown same as for two story house.

LOAD PER PILE
 One Story House 14 tons
 Two Story House 21 tons

STANDARD PLAN		
OPERATOR'S HOUSE		
OPERATORS & MACHINERY HOUSE		
DATED: FEB. 20, 1951		
STATE OF LOUISIANA DEPARTMENT OF HIGHWAYS		
DESIGNED: WALTERS	DETAILED: WALTERS	TRACED: J. H. HARRIS
CHECKED: R. A. OLIVIER	CHECKED: R. A. OLIVIER	CHECKED: R. A. OLIVIER
BRIDGE DESIGN SECTION		

NO.	DATE	DESCRIPTION	BY
1-46	Std. Plan No.		
10-17-45	10-17-45	10-17-45	J. A. B.
2-20-51	2-20-51	2-20-51	R. K. W.
10-6-49	10-6-49	10-6-49	C. A. M.
9-2-49	9-2-49	9-2-49	C. A. M.
1-26-49	1-26-49	1-26-49	C. A. M.
10-19-48	10-19-48	10-19-48	C. A. M.
6-46	6-46	6-46	C. A. M.