
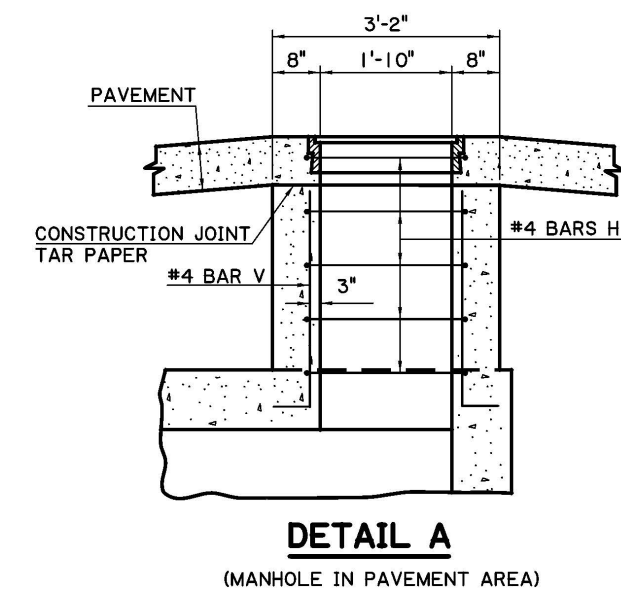
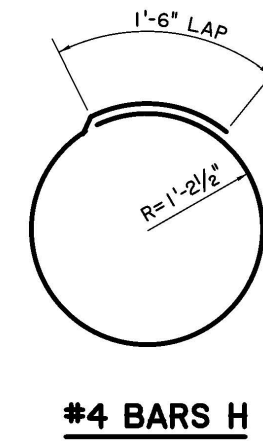
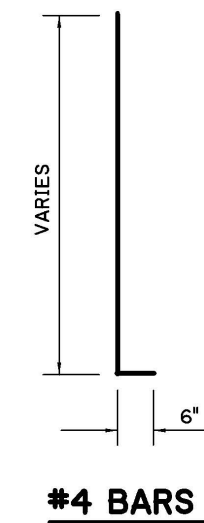
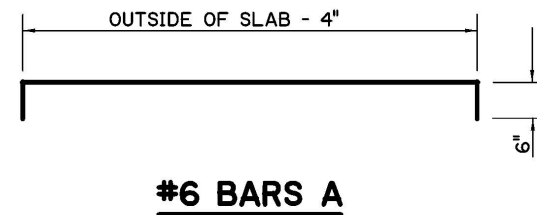
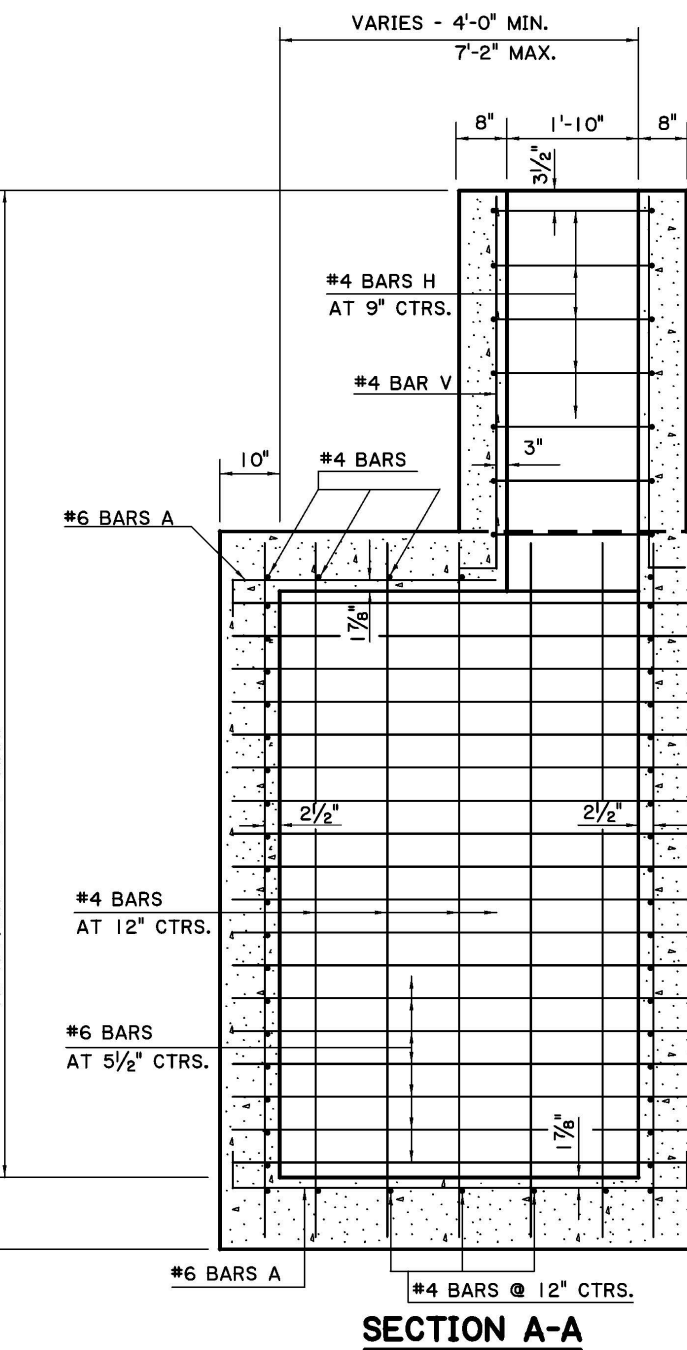
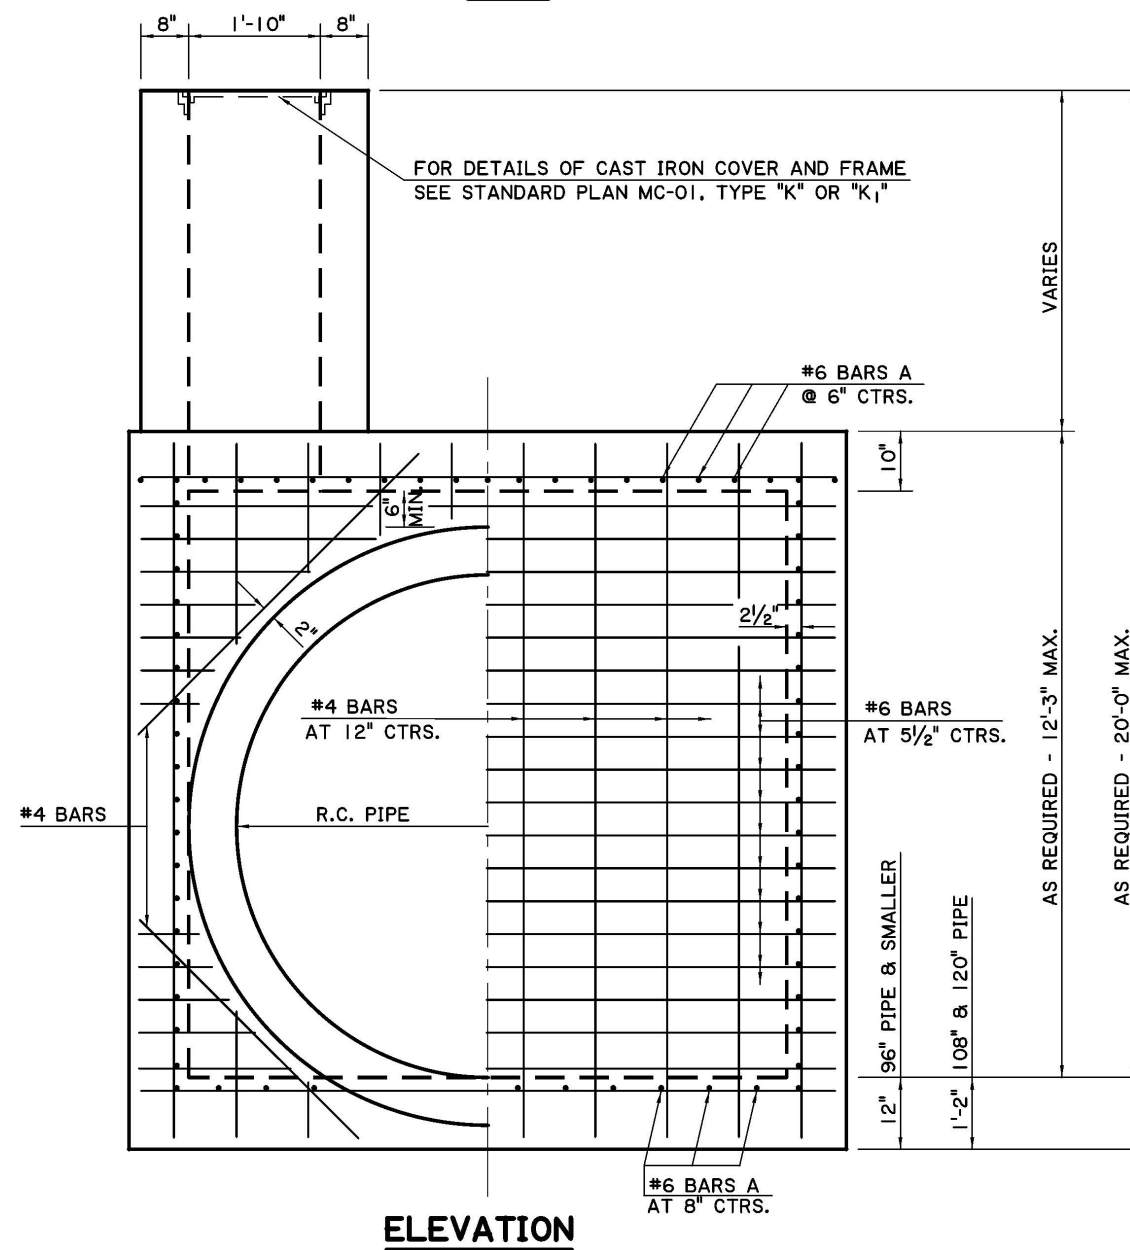


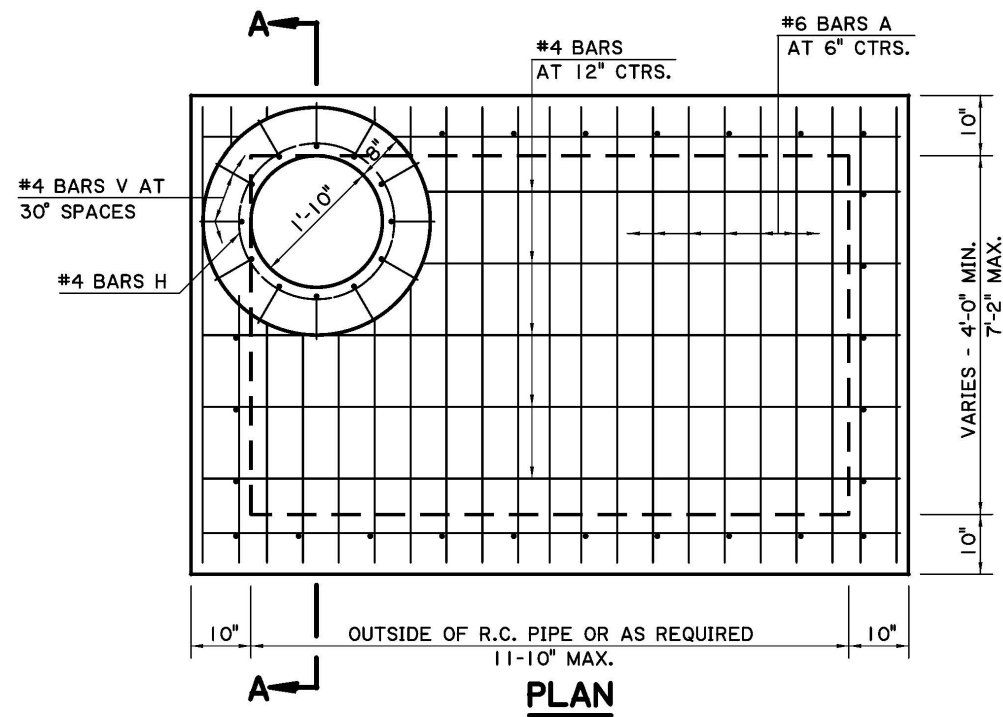

GENERAL NOTES:

1. MANHOLE IS DESIGNED ACCORDING TO 4TH ED. 2007 AASHTO LRFD PROCEDURES. SECTION 702 OF THE DOTD STANDARD SPECIFICATIONS SHALL APPLY.
2. CONCRETE: ALL CONCRETE SHALL BE CLASS "M" MINOR STRUCTURE. ALL EXPOSED EDGES SHALL BE CHAMFERED 3/4 IN. EXCEPT AS NOTED.
3. REINFORCING STEEL: REINFORCING STEEL SHALL BE GRADE 60. DIMENSIONS ARE TO BAR CENTERS. MINIMUM COVER FOR REINFORCING BARS SHALL BE 2 IN. CLEAR UNLESS SHOWN OTHERWISE.
4. SEE "DETAIL A" FOR DETAILS OF MANHOLE IN A PAVEMENT AREA.
5. THE CONTRACTOR WILL NOT POUR ABOVE THE BOTTOM OF THE SLAB UNTIL THE PAVING ADJACENT TO THE MANHOLE HAS BEEN COMPLETED.

SHEET NUMBER		PARISH		CDJ		HJB		CDJ		HJB		STATE PROJECT					
DESIGN		CHECK		DETAIL		CHECK		REVIEW		SERIES		1 OF 1					
APPROVED BY CHIEF ENGINEER:												DATE: 6/1/2026					
REVISION OR CHANGE ORDER DESCRIPTION												NO.		DATE		BY	
R.C. MANHOLE MAXIMUM DIMENSIONS: 11'10" X 7'2" MAXIMUM DEPTH: 20' MH-06																	
STATE OF LOUISIANA DEPARTMENT OF TRANSPORTATION & DEVELOPMENT STANDARD PLAN																	