


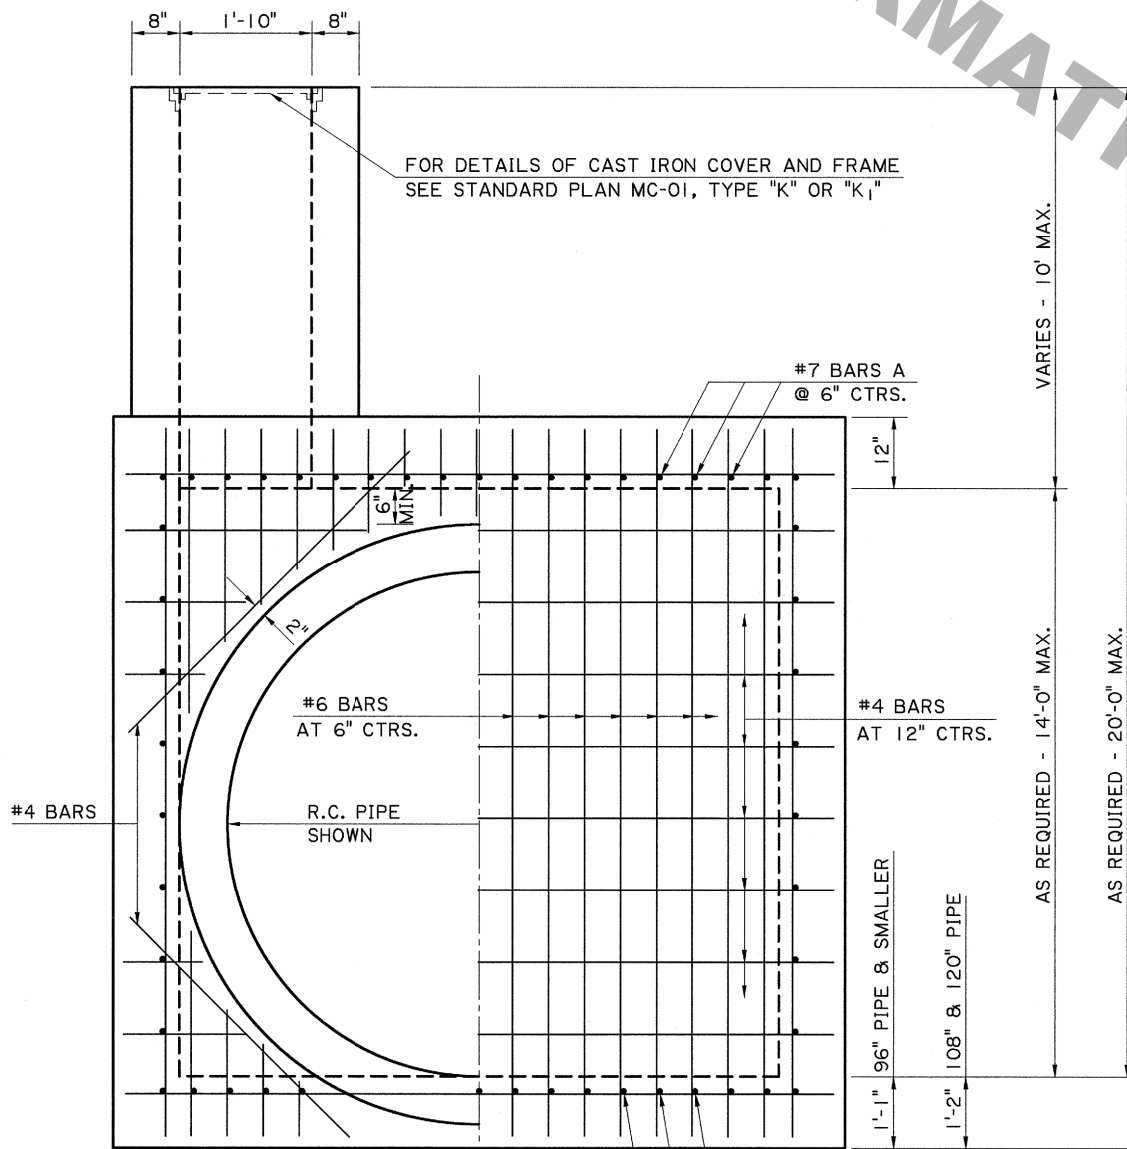
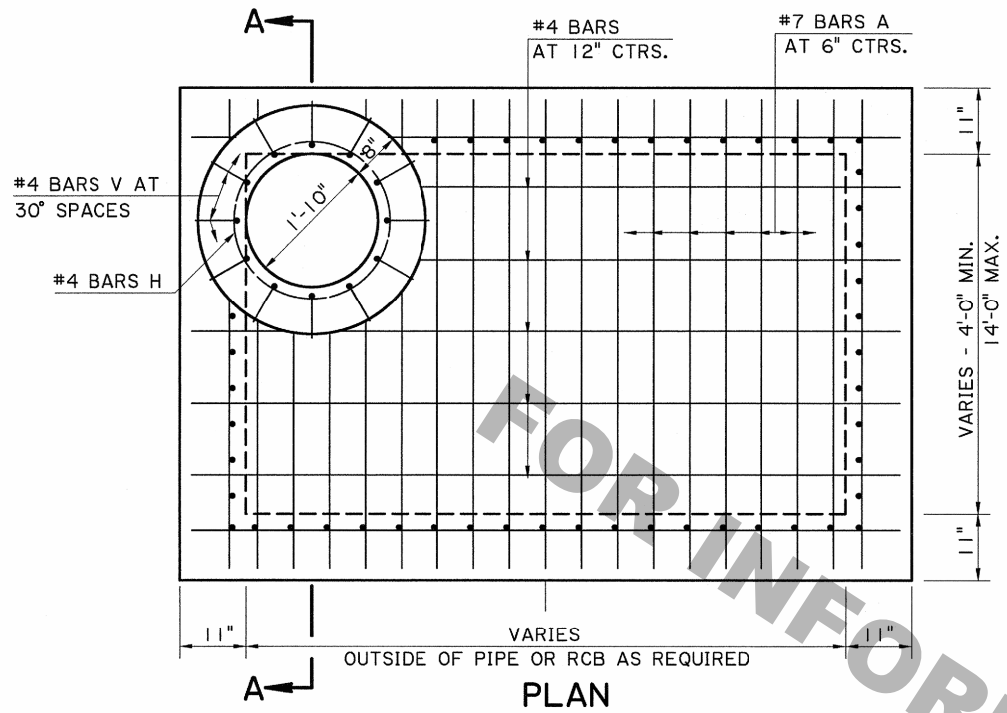
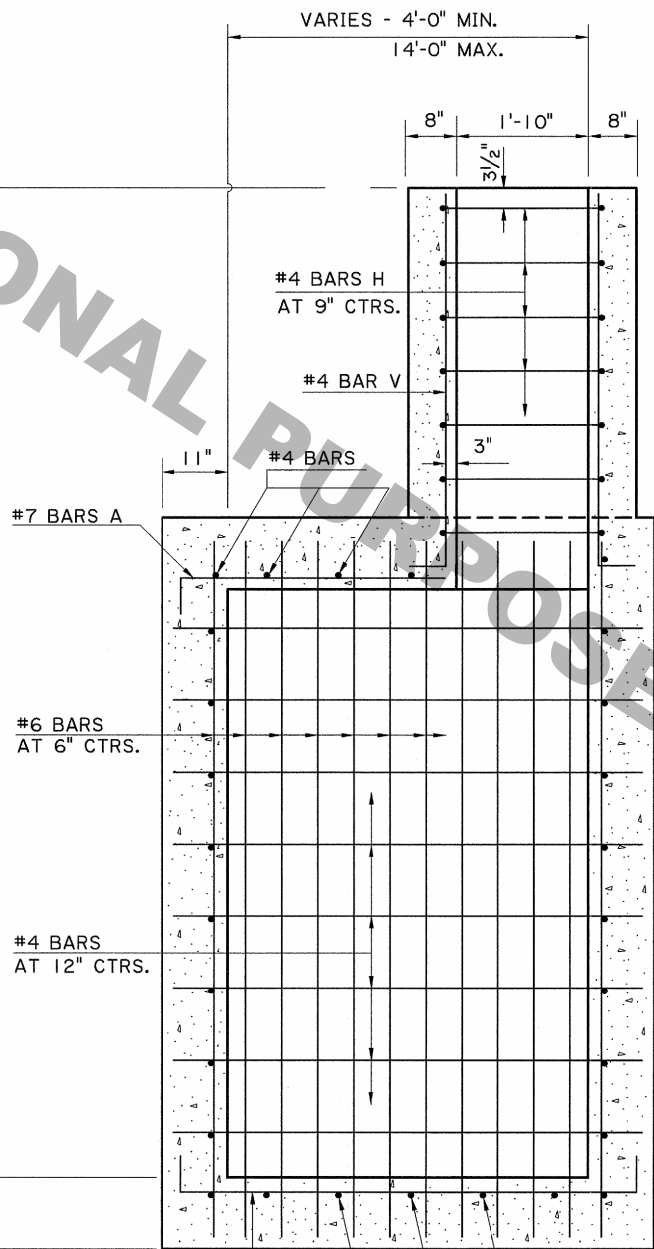
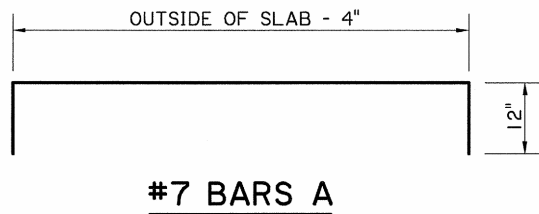


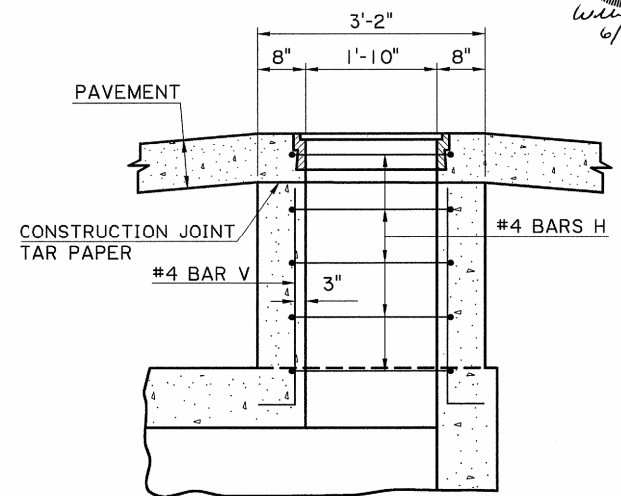

ELEVATION

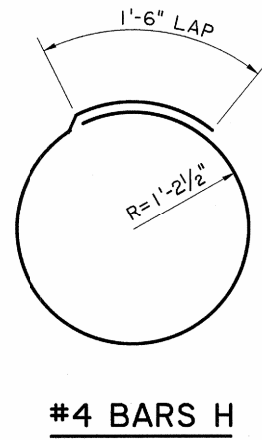

SECTION A-A

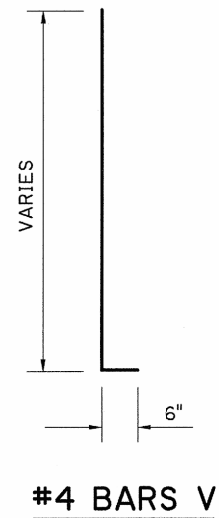

DETAIL A
(MANHOLE IN PAVEMENT AREA)

- GENERAL NOTES:
- MANHOLE IS DESIGNED ACCORDING TO 4TH ED. 2007 AASHTO LRFD PROCEDURES. SECTION 702 OF THE DOT STANDARD SPECIFICATIONS SHALL APPLY, UNLESS OTHERWISE NOTED.
 - CONCRETE: ALL CONCRETE SHALL BE CLASS "A". ALL EXPOSED EDGES SHALL BE CHAMFERED 3/4 IN. EXCEPT AS NOTED.
 - REINFORCING STEEL: REINFORCING STEEL SHALL BE GRADE 60. DIMENSIONS ARE TO BAR CENTERS. MINIMUM COVER FOR REINFORCING BARS SHALL BE 2 IN. CLEAR UNLESS SHOWN OTHERWISE.
 - SEE "DETAIL A" FOR DETAILS OF MANHOLE IN A PAVEMENT AREA.
 - THE CONTRACTOR WILL NOT POUR ABOVE THE BOTTOM OF THE SLAB UNTIL THE PAVING ADJACENT TO THE MANHOLE HAS BEEN COMPLETED.

