

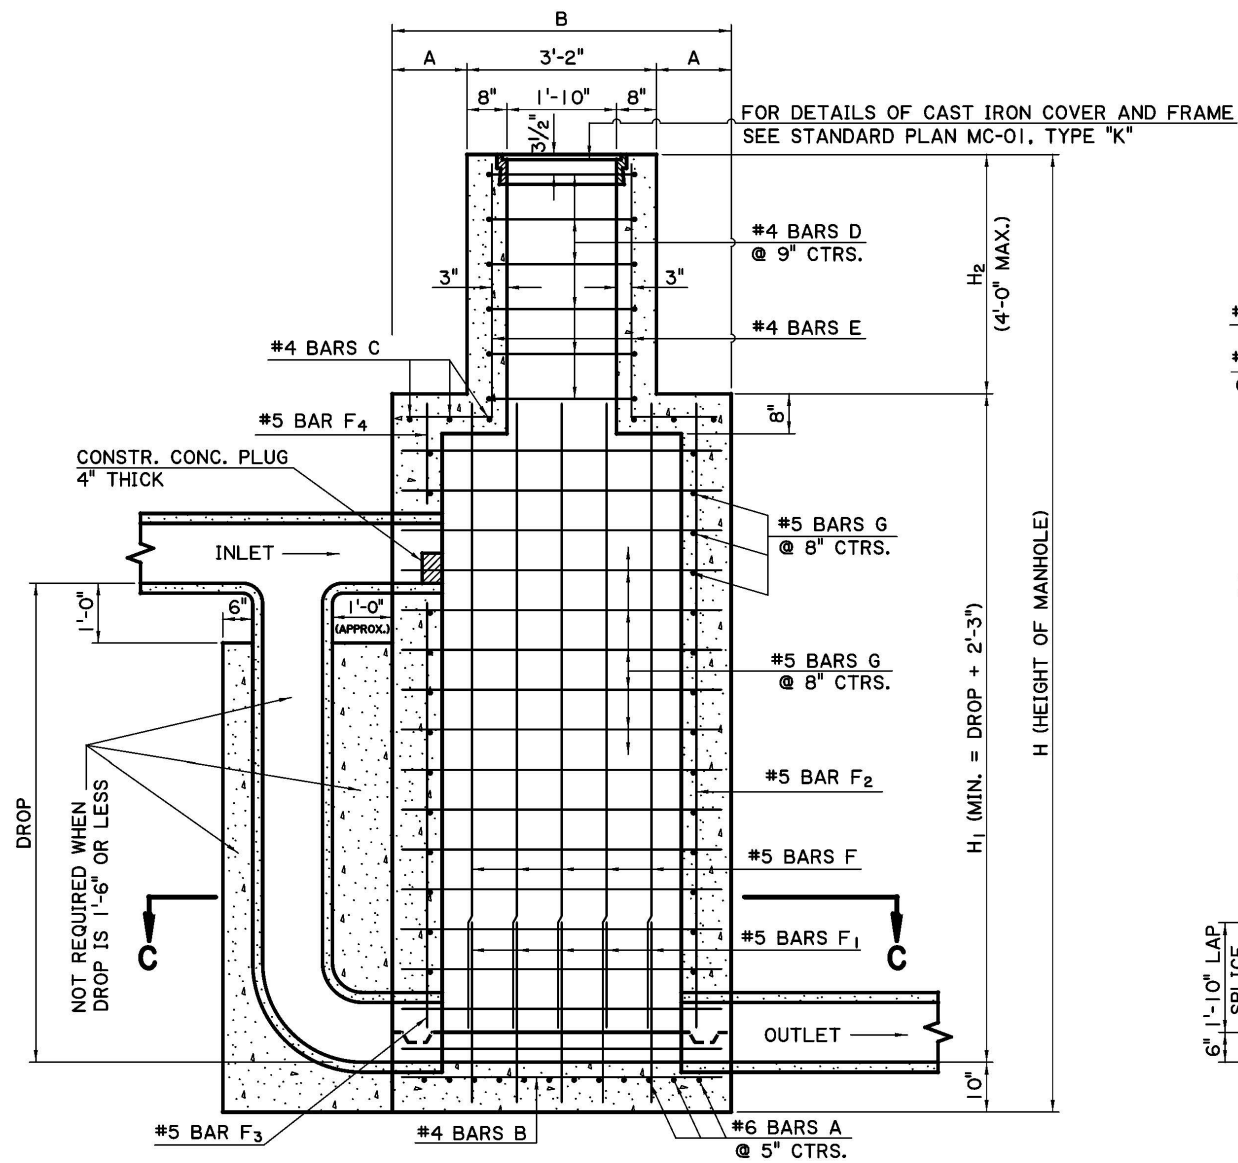


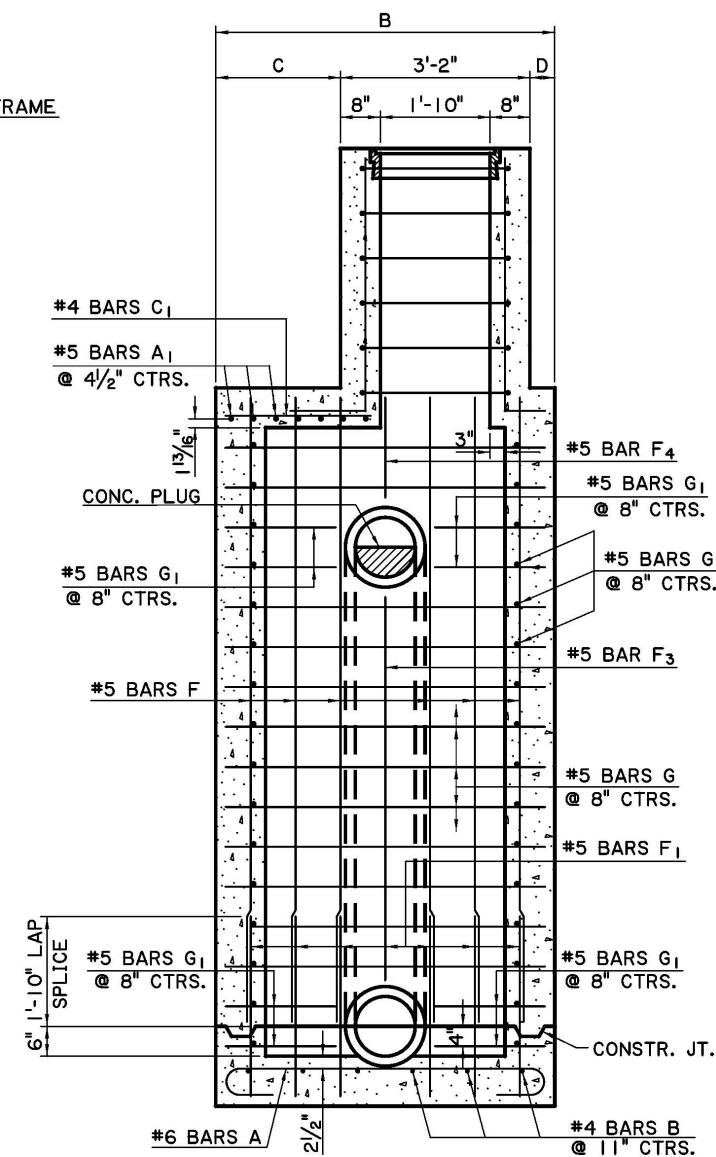


SECTION A-A


NOTE: WHEN DIFFERENCE IN F.L. ELEVATIONS OF INLET AND OUTLET (DROP) DOES NOT EXCEED 1'-6", CONNECTION OF INLET TO MANHOLE WILL BE MADE IN SAME MANNER AS THAT OF OUTLET. (VERTICAL PIPE, ELBOW AND CONCRETE ENCLOSURE NOT REQUIRED)

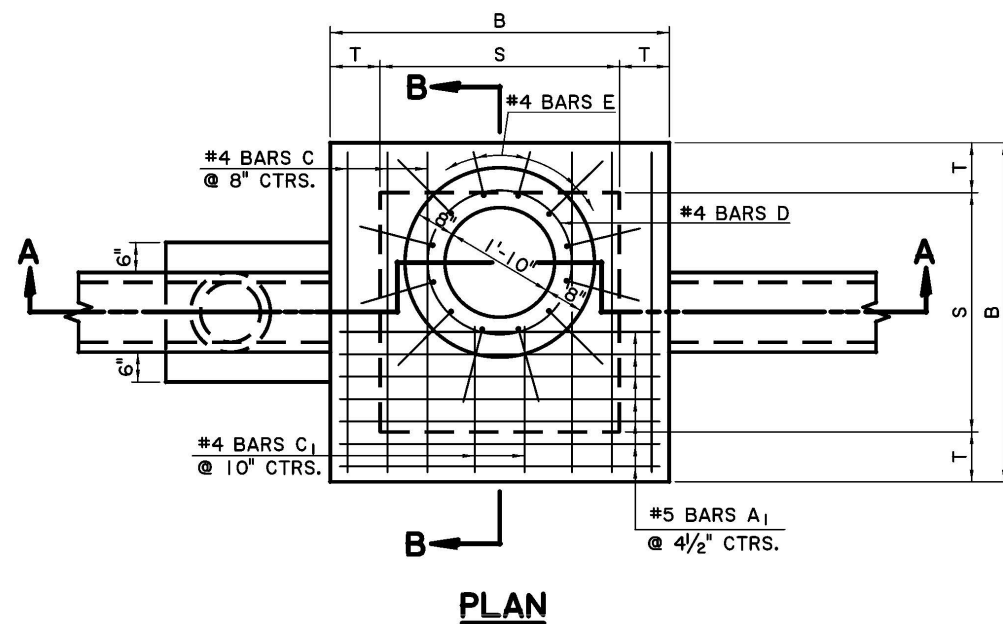


SECTION B-B

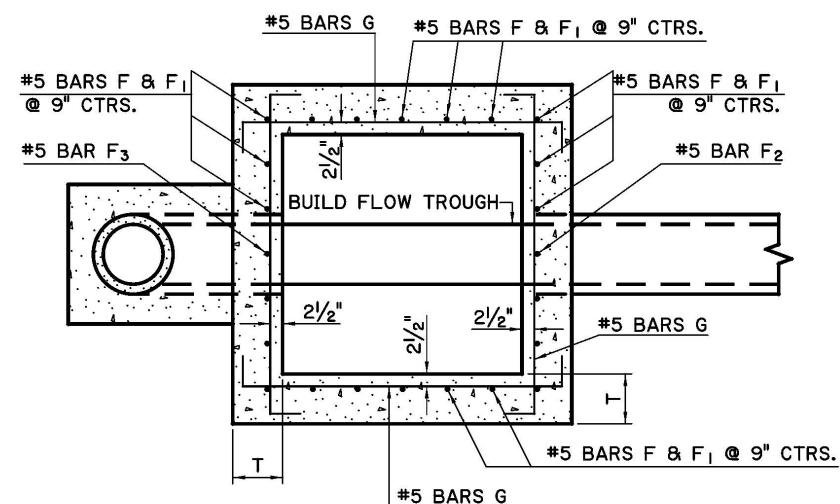


SECTION C-C



#4 BAR D

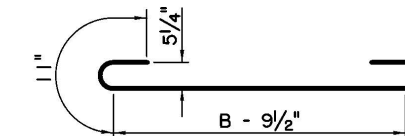


#6 BARS A

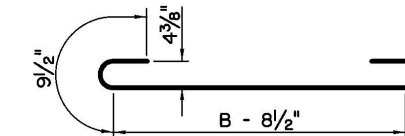

#5 BARS A₁



#5 BARS G

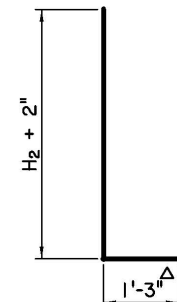


#4 BARS E



Δ TO BE CLIPPED FOR CLEARANCE
(IF NECESSARY)

DIMENSIONS						
H	T	S	B	A	C	D
8' MAX.	8"	3'-6"	4'-10"	0'-10"	1'-5"	0'-3"
8'-1" - 16'	10"	4'-0"	5'-8"	1'-3"	2'-1"	0'-5"
16'-1" - 24'	12"	4'-0"	6'-0"	1'-5"	2'-3"	0'-7"

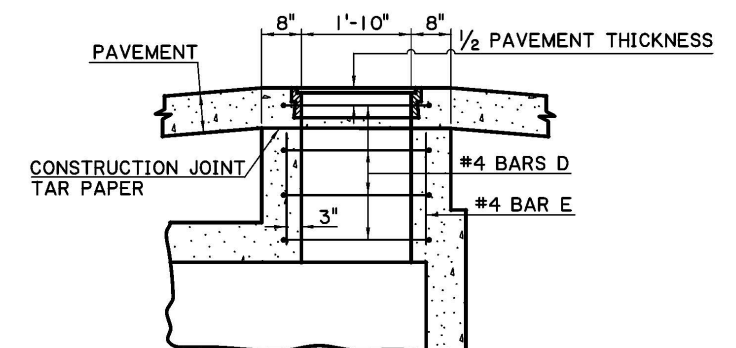

DETAIL A

(MANHOLE IN PAVEMENT AREA)